

# Questions & Answers

## NEC Fuel Dispensing Project

S-IZ100-12-R-0011

February 12, 2012

Rev 1


Question: How much the distance between the cabinet and the GSO building?

Answer: That information is on the hand out - 105 meters or less.

\*\*\*\*\*

Question: Would you please provide the Manufacturer Brand name and MFR model for the existing fuel dispensing pumps.

Answer: The existing dispensing pumps are manufactured by Tokheim. From the pump nameplate: Quantum T: Measuring equipment for Gasoline/Diesel/E85. Serial number: G0717090, installed 2007. Photo below.

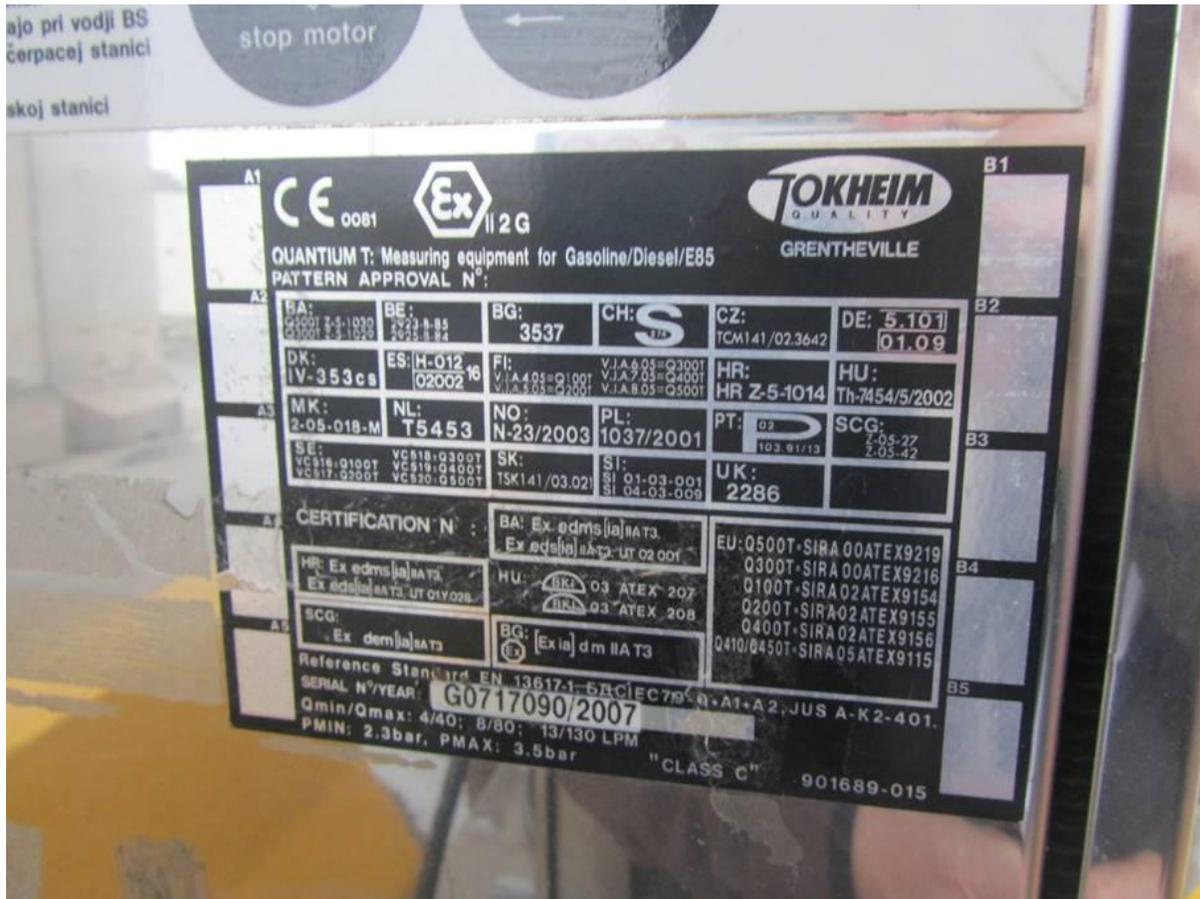

Question: Please, confirm that the existing fuel dispensing pump units will remain and there is no need to be replaced with new ones.

Answer: There is no need to replace the pumps themselves. They are functional now for dispensing either gas or diesel. Those functions remain. It is the bidder's responsibility to confirm that the proposed control system is compatible with the existing Tokheim pumps.

\*\*\*\*\*

Question: How many tanks will this system be controlling?

Answer: There are no tanks to control, only the (4) pumps, each of which dispenses gas and diesel. A total of 8 hoses.

\*\*\*\*\*