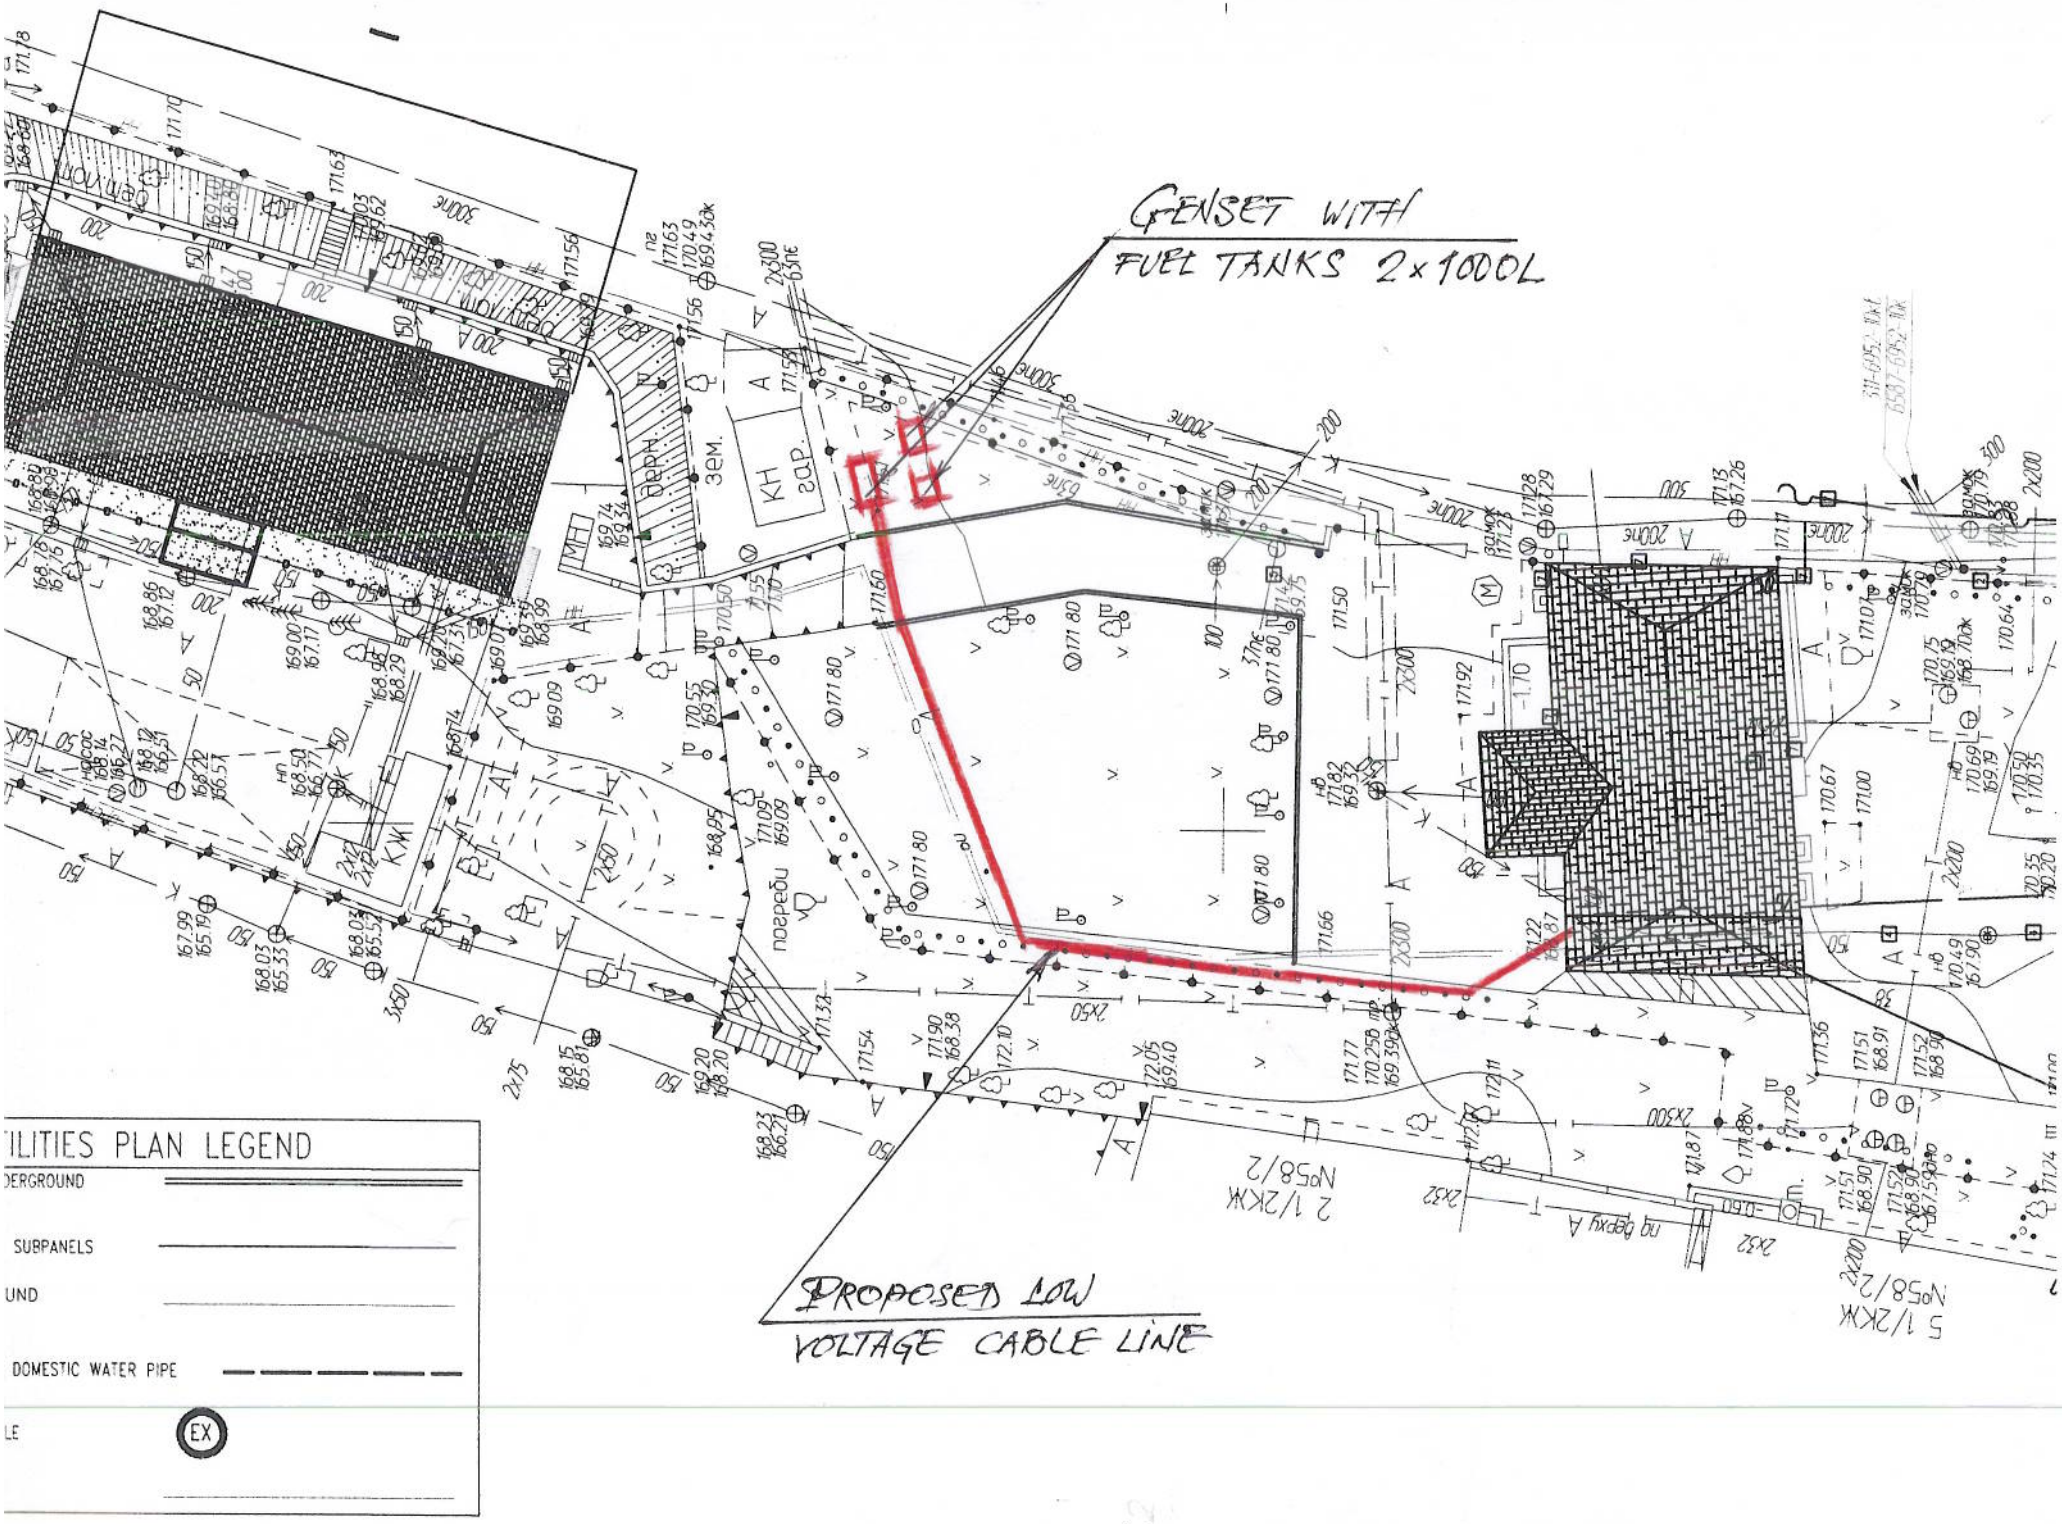
GENSET WITH
FUEL TANKS 2x1000L
PROPOSED LOW
VOLTAGE CABLE LINE
ILITIES PLAN LEGEND
DERGROUND
SUBPANELS
UND
DOMESTIC WATER PIPE
LE
EX

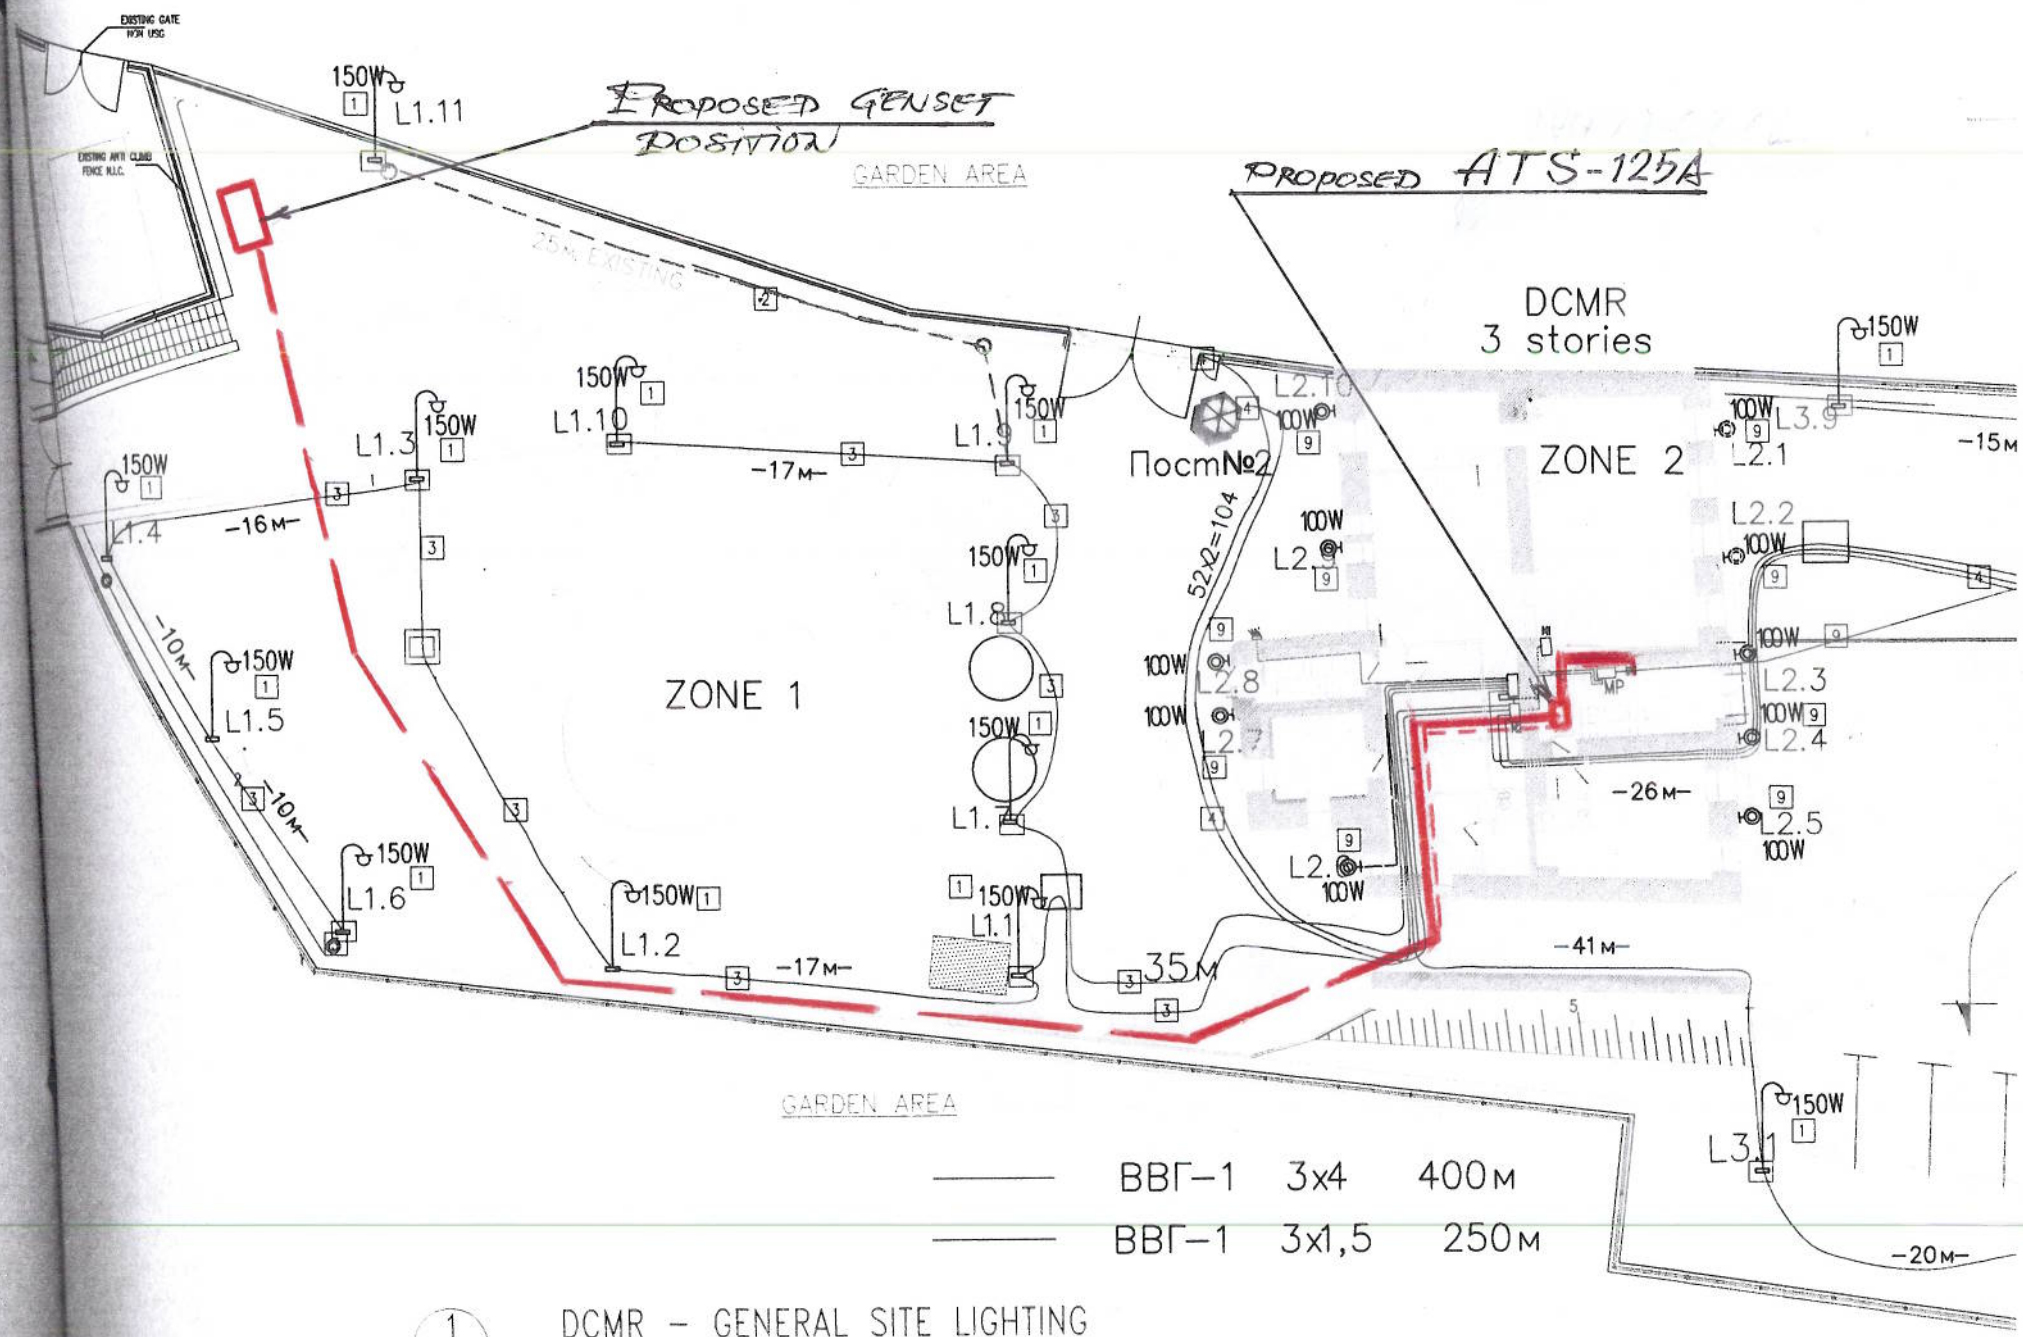

1 DCMR - GENERAL SITE LIGHTING

A1.01 E1.01 1/300

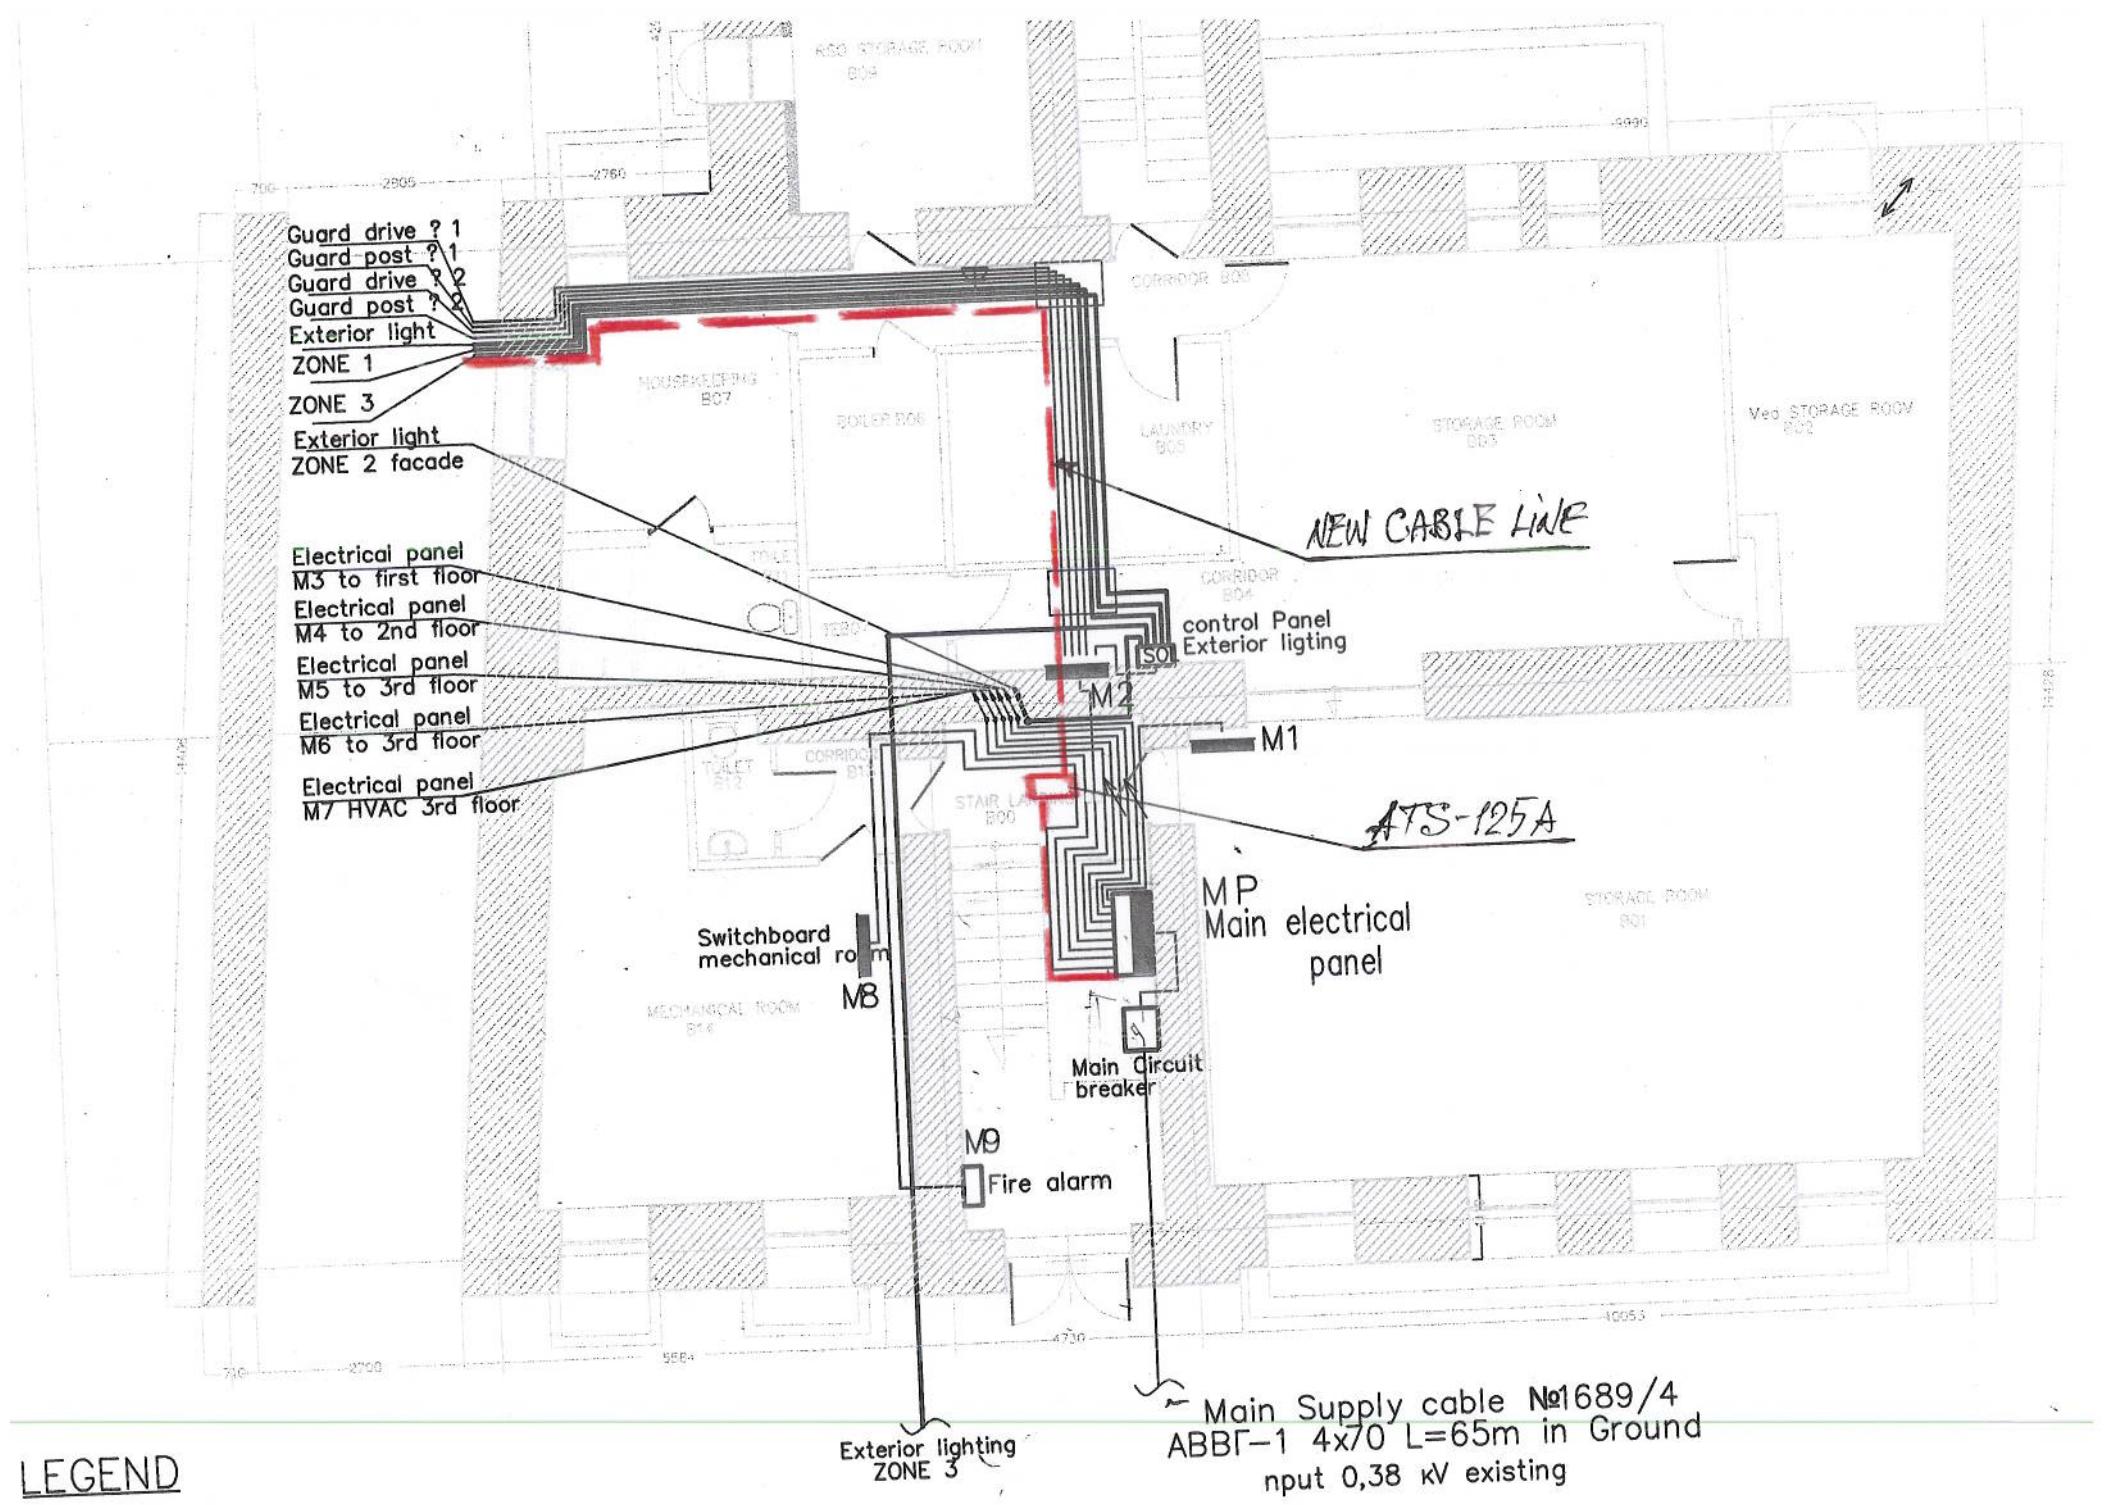

LEGEND

MP MAIN POWER PANEL

SO1 EXTERIOR LIGHT CONTROL PANEL

DCMP BASEMENT – MAIN PANEL SCHEDULE

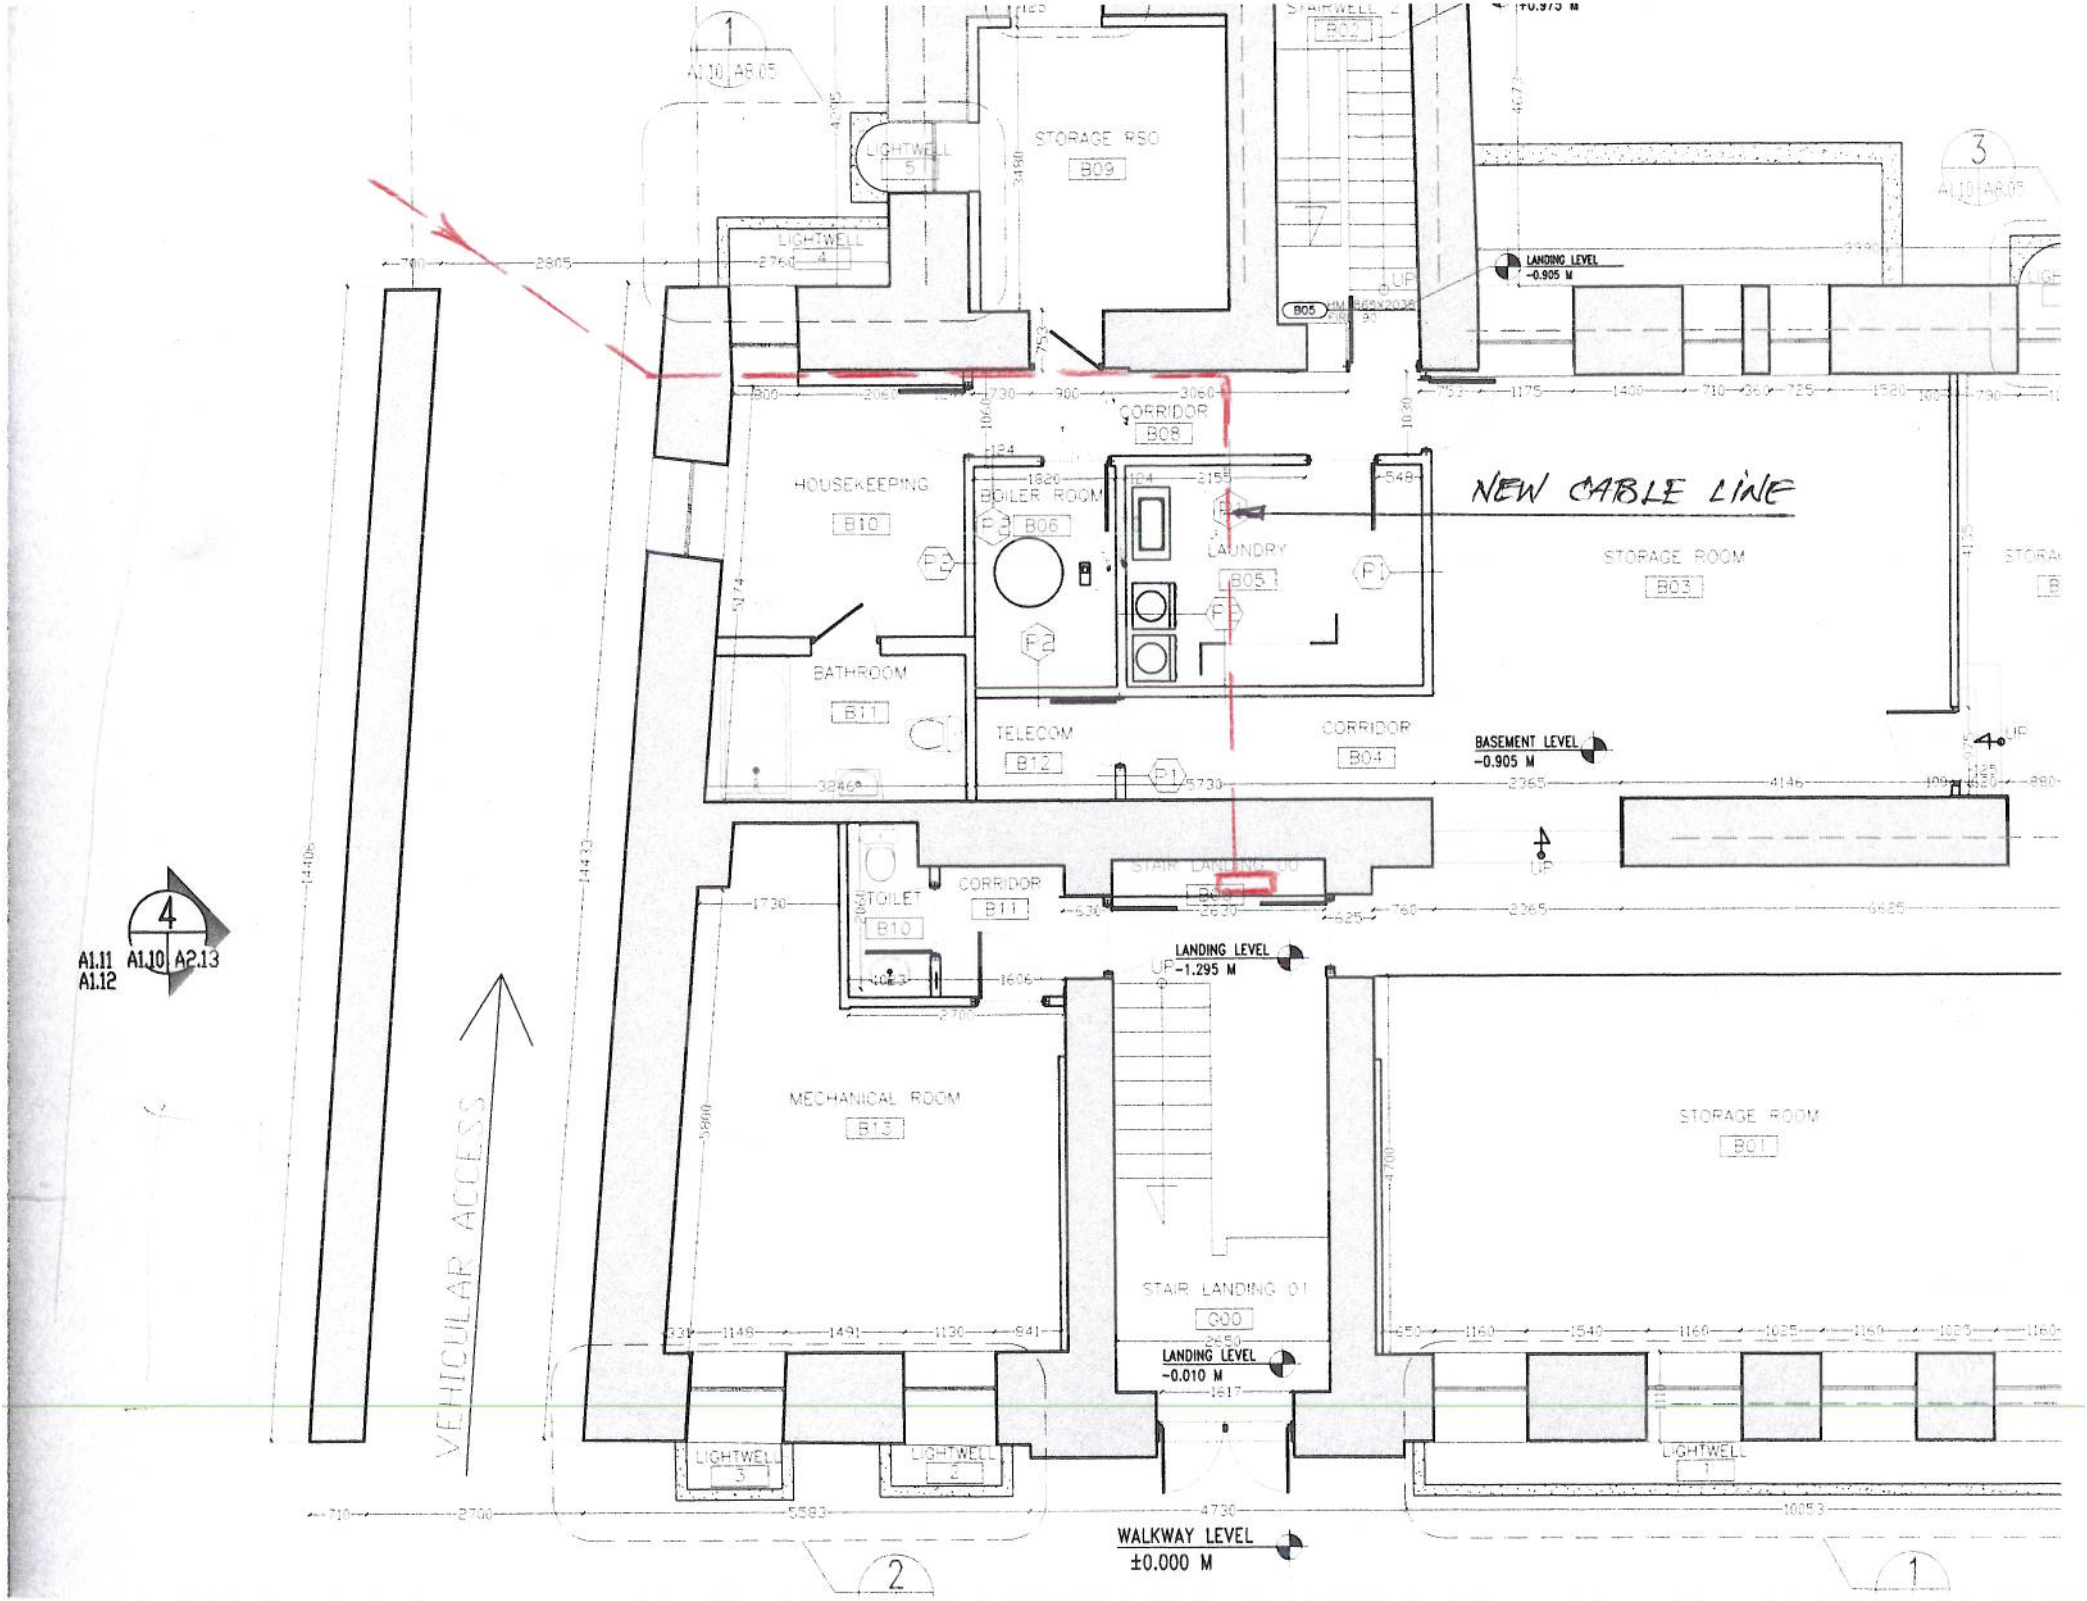
NEW CABLE LINE
STORAGE RSO
B09
LIGHTWELL 5
LIGHTWELL 4
CORRIDOR
B08
HOUSEKEEPING
B10
BOILER ROOM
B06
LAUNDRY
B05
STORAGE ROOM
B03
BATHROOM
B11
TELECOM
B12
CORRIDOR
B04
BASEMENT LEVEL
-0.905 M
LANDING LEVEL
-0.905 M
TOILET
B10
CORRIDOR
B11
LANDING LEVEL
-1.295 M
MECHANICAL ROOM
B13
STORAGE ROOM
B01
STAIR LANDING 01
G00
LANDING LEVEL
-0.010 M
LIGHTWELL 3
LIGHTWELL 2
LIGHTWELL 1
VEHICULAR ACCESS
WALKWAY LEVEL
±0.000 M
A1.11
A1.12
A1.10
A2.13

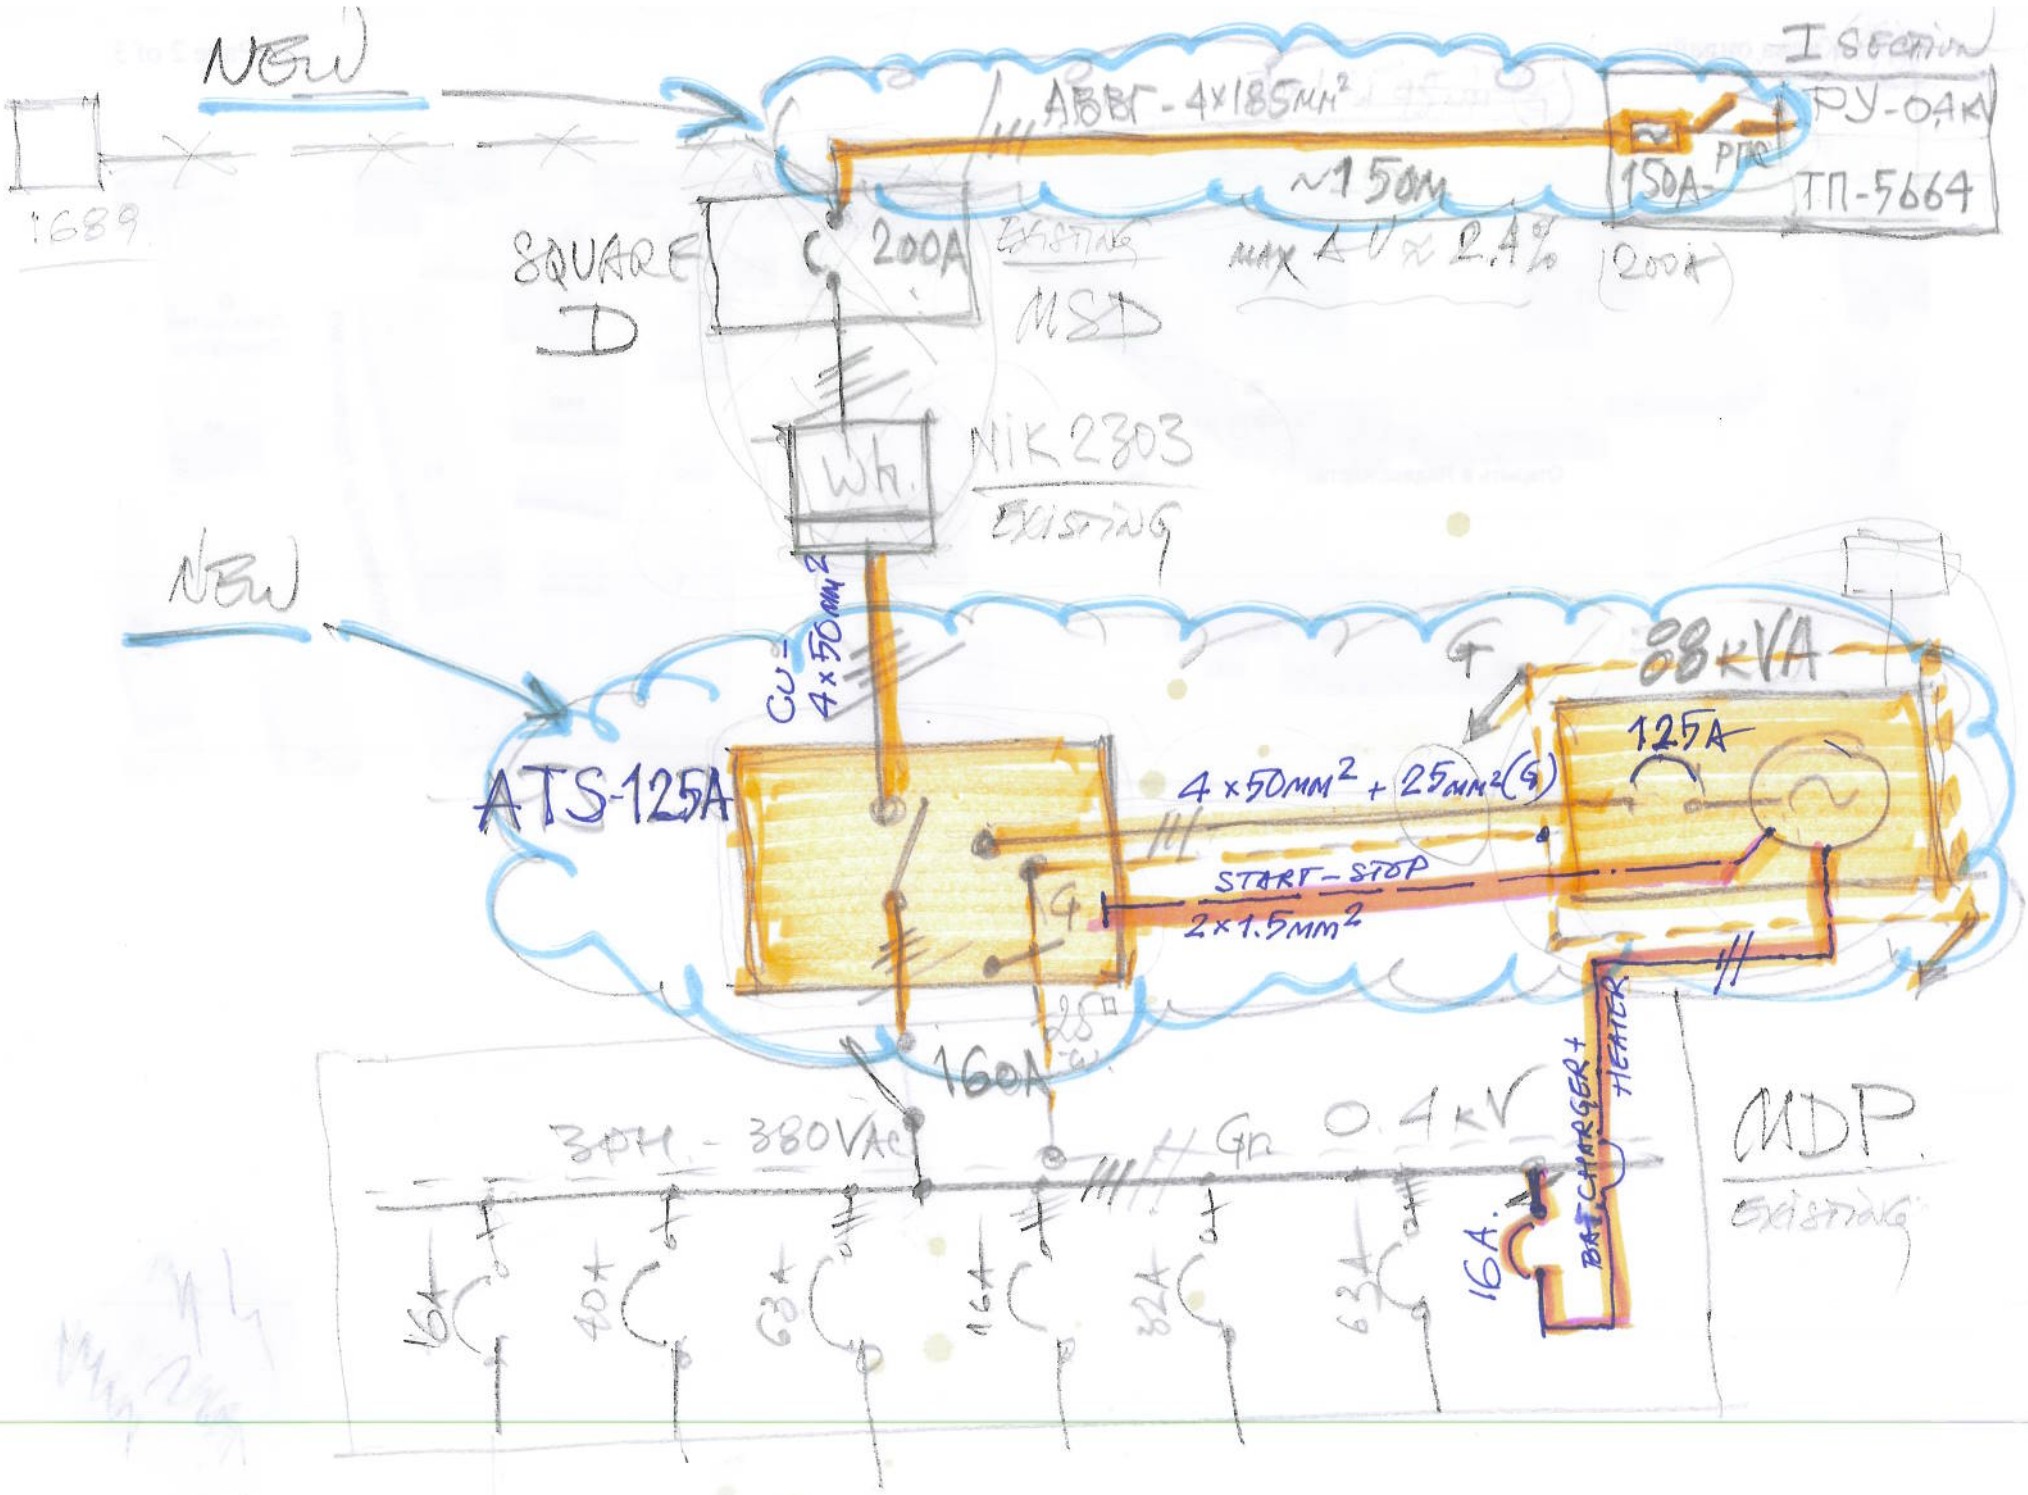
NEW
1689
АВВГ - 4×185мм²
~150м
I SECTION
РУ-0,4кV
ТП-5664
150A
PTC
200A
SQUARE D
EXISTING
MSD
max ΔU ≈ 2.4%
(200A)
Wh.
NIK 2303
EXISTING
NEW
CU - 4×50мм²
ATS-125A
4×50мм² + 25мм²(G)
G
88kVA
125A
START - STOP
2×1.5мм²
160A
3PH - 380VAC
Gr
0.4kV
BAT CHARGER + HEATER
16A
MDP
EXISTING
16A
40A
63A
16A
32A
63A